

Firestop Collar (CP 643N)

Product description

- A ready-to-use firestop collar, made of a galvanized steel housing and intumescent inserts for firestopping combustible pipes

Product features

- Ready-to-use collar
- No construction required
- Fast installation time
- Adjustable mounting tabs
- Low profile for tight installations

Areas of application

- Firestopping combustible pipes up to 6" diameter in penetrations through fire walls and floors
- Suitable for the following pipe materials:
- PVC, CPVC, ABS, PVDF, PP and FRPP

For use with


- Concrete, masonry, wood floor and gypsum wall assemblies
- Wall and floor assemblies rated up to 4 hours

Types of installation


- Wall: two collars, one on each side
- Floor: one collar on underside (bottom)

Example

- Waste water pipes
- Fresh water pipes

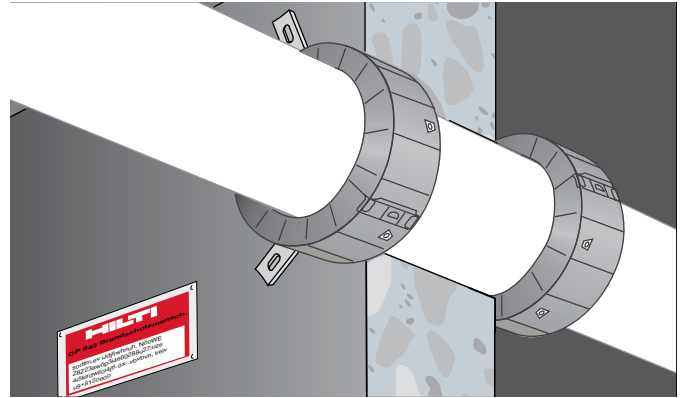

Technical Data		CP 643N		
Description	Pipe outside dia. (in.)	Collar outside dia. (in.)	Collar Height (in.)	No. of hooks and fasteners
CP 643-50/1.5"N	1.4-2.0	2.8	0.9	2
CP 643-63/2"N	2.0-2.5	3.4	1.3	2
CP 643-90/3"N	2.6-3.6	4.9	1.7	3
CP 643-110/4"N	3.6-4.5	6.0	1.9	3
CP 643-160/6"N	6.6	9.8	1.9	4
Temperature resistance		-40°F to 140°F (-40°C to 60°C)		
Intumescent activation		Approx. 392°F (200°C)		
Expansion ratio (unrestricted)		Up to 1:10		
Tested in accordance with				
• UL 1479 • ASTM E 814 • ASTM G21 • CAN/ULC-S115				

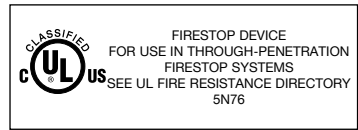

Installation instructions for CP 643N

Notice

- Before handling, read Material Safety Data Sheet and product label for safe usage and health information.
- Instructions below are general guidelines — always refer to the applicable drawing in the UL Fire Resistance Directory or Hilti Firestop Systems Guide for complete installation information

Opening

1. Clean the plastic pipes. Expansion of the intumescent material during a fire acts to close the plastic pipe. Very dirty pipes (ie: with remains of mortar) may lead to a delay in this closing action. Soiled plastic pipes should, therefore, be cleaned in the area where the CP 643N Firestop Collar is to be installed.

Application of firestop system

2. Seal the opening if required. Gaps may be closed with FS-ONE. The approved methods vary and are given in the specific UL system.
3. Close the CP 643N Firestop Collar. Place the CP 643N Firestop Collar around the plastic pipe and lock the closure by applying firm pressure until it latches.
4. Attach fastening hooks. The fastening hooks can be attached to various points on the metal housing. This allows the fastening points to be made to suit the space available in each case. The hooks must be positioned as symmetrically as possible. The required number of fastening hooks is indicated on the packaging.


5. Fastening the CP 643N Firestop Collar. Only when fastened properly can CP 643N offer protection against fire.
 - a. Mark the fastening points.
 - b. Drill holes with a Hilti rotary hammer drill (i.e. TE 4-A18) or, depending on base material, fasten using Hilti powder-actuated tool.
 - c. To secure the CP 643N Firestop Collar, use Hilti anchors/fasteners.
 - d. For maintenance reasons, a penetration can be permanently marked with an identification plate and fastened in a visible position next to the seal.

Not for use

- With metal pipes
- In highly corrosive surroundings
- With unapproved anchors/fasteners

Storage

- Store only in the original packaging in a location protected from moisture

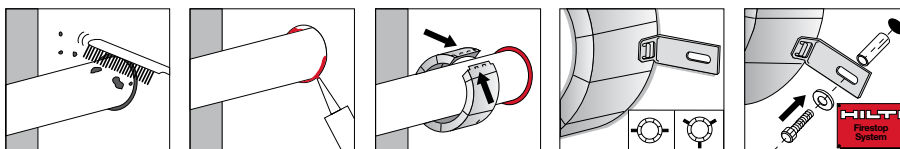

1. Clean plastic pipe.
2. Close remaining gap to provide smoke and gas resistant seal.
3. Close collar.
4. Attach fastening hooks.
5. Fasten collar and identification plate (if required).

Hilti. Outperform. Outlast.

Hilti (Canada) Corp. 1-800-363-4458 • www.hilti.ca • Hilti Firestop Systems Guide — Canada

