




Classified by
Underwriters Laboratories, Inc.
to CAN/ULC-S115

System No. W-J-2245

F Rating - 2 Hr
FT Rating - 2 Hr
FH Rating - 2 Hr
FTH Rating - 2 Hr



WJ 2245

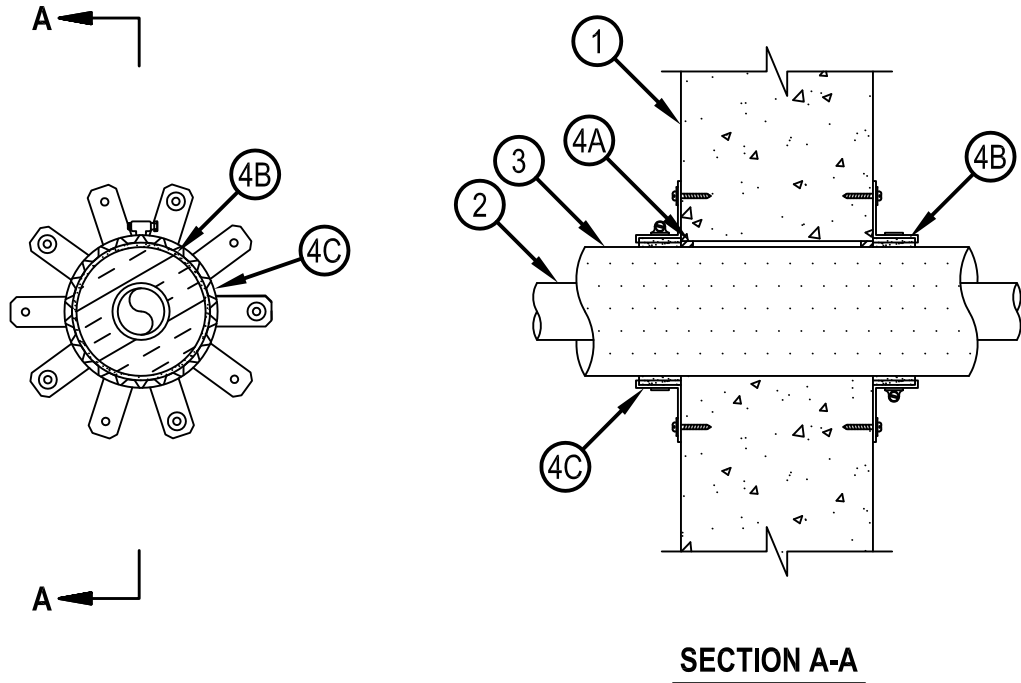


System tested with a pressure differential of 50 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.

1. Wall Assembly — Min 152 mm (6 in.) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diam of opening is 149 mm (5-7/8 in.).

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. Through Penetrants — One nominal 51 mm (2 in.) diam Schedule 80 polypropylene pipe installed either concentrically or eccentrically within the firestop system. Pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems. Pipe to be rigidly supported on both sides of wall assembly.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
January 22, 2015

3. Pipe Covering — One of the following types of pipe covering shall be used:

A. Tube Insulation - Plastic+ — Nom 25 mm (1 in.) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. Annular space between the insulated penetrant and periphery of opening shall be min 0 mm (point contact, 0 in.) to max 6 mm (1/4 in.).

See Plastics+ (QMFZ2) category in the Plastic Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL94 Flammability Classification of 94-5VA may be used.

B. Pipe Covering* — Nom 38 mm (1-1/2 in.) thick hollow cylindrical heavy density min 56 kg/m³ (3.5 pcf) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product. Annular space between the insulated penetrant and periphery of opening shall be min 0 mm (point contact, 0 in.) to max 6 mm (1/4 in.).

See Pipe and Equipment Covering - Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

C. Pipe Covering* — Nom 38 mm (1-1/2 in.) thick unfaced mineral fiber pipe insulation having a nom density of min 56 kg/m³ (3.5 pcf) and sized to fit the outside diam of pipe or tube. Pipe insulation secured with min 18 AWG steel wire spaced 305 mm (12 in.) OC. Annular space between the insulated penetrant and periphery of opening shall be min 0 mm (point contact, 0 in.) to max 6 mm (1/4 in.).

See Pipe and Equipment Covering Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

D. Sheathing Material* — Used in conjunction with Item 3C. Foil-scrim-kraft or all service jacket material shall be wrapped around the outer circumference of the pipe insulation (Item 3B) with the kraft side exposed. Longitudinal joints and transverse joints sealed with metal fasteners or butt tape.

See Sheathing Materials (BVDV) category in the Building Materials Directory for names of manufacturers. Any sheathing material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

4. Firestop System — The firestop system shall consist of the following:

A. Fill, Void or Cavity Material* — Sealant — Min 13 mm (1/2 in.) thickness of fill material applied within annulus, flush with both surfaces of wall assembly.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant.

B. Fill, Void or Cavity Material* — Wrap Strip — Nom 4.8 mm (3/16 in.) thick by 45 mm (1-3/4 in.) wide intumescent wrap strip. Two layers of wrap strip are continuously wrapped around the pipe and held in place with tape.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — Hilti CP 648E/1-3/4 Wrap Strip

C. Steel Collar — Collar fabricated from coils of precut min 0.43 mm (0.017 in.) thick (No. 28 MSG) galv steel available from the sealant manufacturer. Collar shall be nom (45 mm 1- 3/4 in.) deep with 25 mm (1 in.) wide by 51 mm (2 in.) long anchors tabs on 51 mm (2 in.) centers for securement to wall assembly. The anchor tabs shall be bent 90 degree outward for securement to the wall assembly. The opposite side incorporates retainer tabs, 13 mm (1/2 in.) wide by 5 mm (3/16 in.) long, prebent toward the pipe surface. Collar shall be tightly wrapped over the wrap strip, overlapping min 25 mm (1 in.) at seam. A nom 13 mm (1/2 in.) wide stainless steel band clamp shall be secured to the collar at its mid-height. Anchor tabs of collar secured to both surfaces of by means of min 6 mm (1/4 in.) diam by 32 mm (1-1/4 in.) long steel expansion bolts in conjunction with 32 mm (1-1/4 in.) diam steel fender washers. A collar is used on both sides of wall

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

+Bearing the UL Recognized Component Mark

