




Classified by
Underwriters Laboratories, Inc.
to CAN/ULC-S115

System No. F-A-0001

F Rating — 2 Hr
FT Rating — 1 Hr
FH Rating — 0 Hr
FTH Rating — 0 Hr



FA 0001

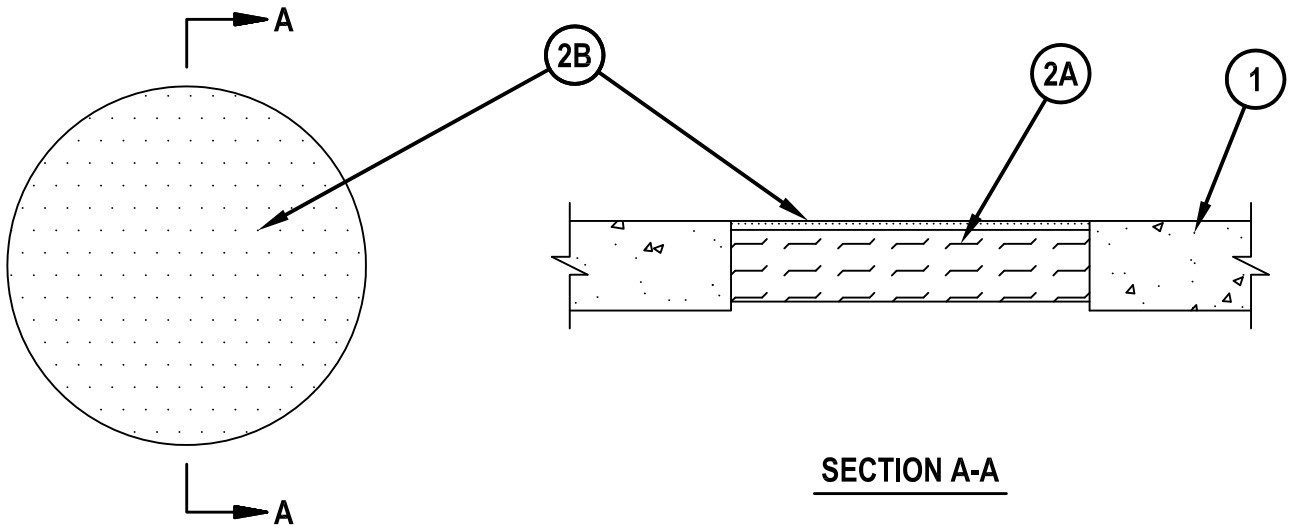

1. Floor Assembly — Min 64 mm (2-1/2 in.) thick reinforced lightweight or normal weight 1600-2400 kg/m³ (100-150 pcf) concrete. Max diam of opening is 254 mm (10 in.)
 2. Firestop System — The firestop system shall consist of the following:
 - A. Packing Material — Min 51 mm (2 in.) thickness of min 64 kg/m³ (4.0 pcf) mineral wool batt insulation tightly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.
 - B. Fill, Void or Cavity Material* — Caulk — Min 6 mm (1/4 in.) thickness of fill material applied within the annulus, flush with the top surface of floor or with both surfaces of wall.
- HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 604 Self-Leveling Firestop Sealant, CFS-S SIL GG or CFS-S SIL SL Sealant

*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
December 26, 2013