




Classified by
Underwriters Laboratories, Inc.
to CAN/ULC-S115

System No. W-J-2030
F Rating — 2 Hr
FT, FH and FTH Ratings — 0 Hr




WJ 2030

FRONT VIEW

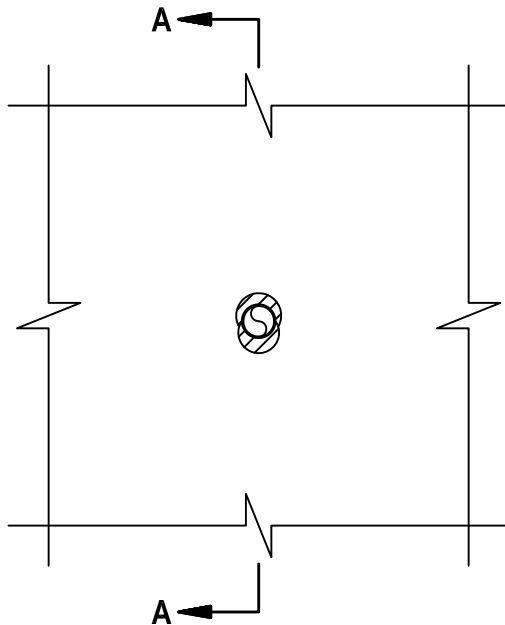

SECTION A-A

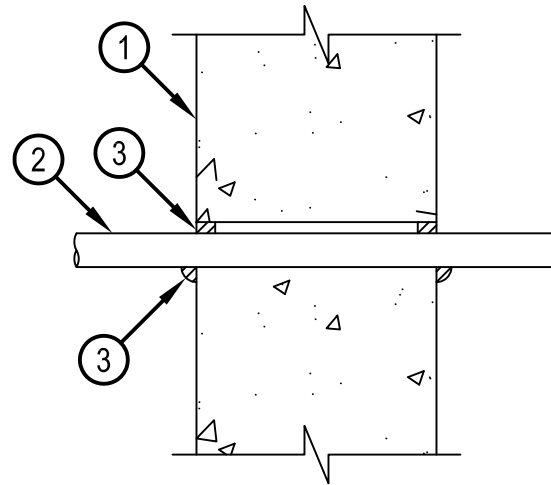

System tested with a pressure differential of 50 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.

1. Wall Assembly — Min 150 mm (6 in.) thick reinforced lightweight or normal weight (1600 - 2400 kg/cu meter, 100 - 150 pcf) concrete wall assembly. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diam of opening 38 mm (1-1/2 in.).
See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. Cross-Linked Polyethylene (PEX) Tubing — Nom 25 mm (1 in.) diam (or smaller) SDR 9 PEX tubing. One nonmetallic pipe to be installed concentrically or eccentrically within the firestop system. Annular space between pipe and periphery of opening to be min 0 mm, (point contact), to max 10 mm (3/8 in.).
3. Fill, Void or Cavity Material* — Sealant - Minimum 16 mm (5/8 in.) thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point contact location between pipe and concrete, a minimum 13 mm (1/2 in.) diameter bead of fill material shall be applied at the concrete/pipe interface at both surfaces of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
January 21, 2015