





Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. F-A-8012

FA 8012

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Rating — 0 Hr	FT Rating — 0 Hr
	FH Rating — 2 Hr
	FTH Rating — 0 Hr

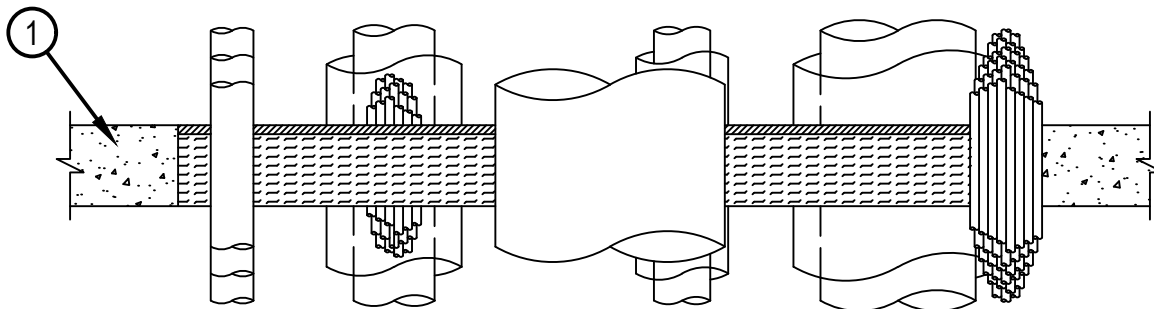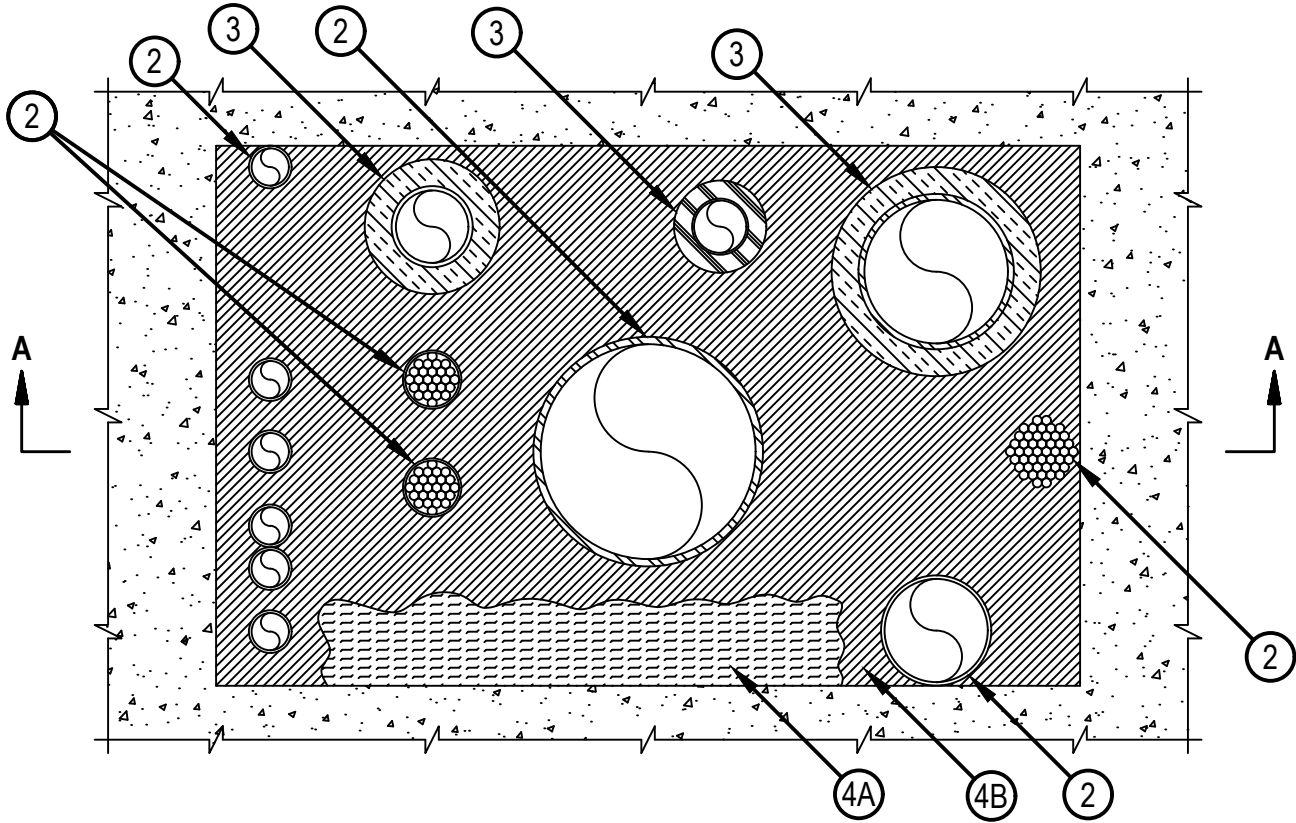

SECTION A-A



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
June 23, 2016

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Max size of opening is 1440 in.² (9290 cm²) with a max dimension of 48 in. (1219 mm).
2. Through-Penetrants — One or more pipes, tubes or cable bundles to be installed within the opening. The total number of through-penetrants is dependent on the size of the opening and types and sizes of the penetrants. Any combination of the penetrants described below may be used provided that the following parameters relative to the annular spaces are maintained. The annular space between cable bundles and other penetrants shall be a min 6 in. (152 mm). The annular space between metallic pipes, conduit and tubes and insulated pipes and tubes shall be a min 2 in. (51 mm). The annular space between nom 2 in. (51 mm) diam (and smaller) metallic pipes, conduit and tubes shall be a min 0 in. (0 mm). The annular space between insulated penetrants and the periphery of opening shall be a min 1/2 in. (13 mm). The annular space between all other penetrants and the periphery of opening shall be a min 0 in. (0 mm) (point contact). A max annular space in the system shall be 12 in. (305 mm). Penetrants to be rigidly supported on both sides of floor assembly. The following types and sizes of penetrants may be used.
 - A. Metallic Penetrants — The following types of metallic pipes, tubes or conduits may be used:
 1. Copper Tubing — Nom 6 in. (152 mm) diam (or smaller) Type L (or heavier) copper tube.
 2. Copper Pipe — Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) copper pipe.
 3. Steel Pipe — Nom 24 in. (610 mm) diam (or smaller) Schedule 40 (or heavier) steel pipe.
 4. Iron Pipe — Nom 24 in. (610 mm) diam (or smaller) cast or ductile iron pipe.
 5. Conduit — Nom 4 in. (102 mm) diam (or smaller) steel electric metallic tubing (EMT) or nom 6 in. (152 mm) diam (or smaller) rigid steel conduit.
 - B. Cables Bundles — Max 4 in. (102 mm) diam tightly bundled cables. Any combination of the following types and sizes of cables may be used:
 1. Max 500 kcmil single copper or aluminum conductor power cable with thermoplastic insulation and polyvinyl chloride (PVC) jacket.
 2. Max 300 pair No. 24 AWG copper conductor telecommunication cables with PVC insulation and jacket material.
 3. Max 7/C copper conductor No. 12 AWG multi-conductor power and control cables with PVC or cross-linked polyethylene (XLPE) insulation and PVC jacket.
 4. Multiple fiber optical communication cables jacketed with PVC and having a max outside diam of 1/2 in.
 5. Max 3/C No. 12 AWG steel clad cable with copper conductors and PVC insulation material.
 - C. Individual Cables — Any of the following types and sizes of individual (non-bundled) cables may be used:
 1. Max 3/C No. 2/0 AWG (or smaller) copper conductor PVC jacketed aluminum clad or steel clad TECK 90 cable.
 2. Through Penetrating Product* — Any cables, Armored Cable+ or Metal Clad Cable+ currently Classified under the Through Penetrating Product category.

See Through Penetrating Product (XHLY) category in the Fire Resistance Directory for names of manufacturers.
 3. Max 500 kcmil single copper or aluminum conductor power cable with thermoplastic insulation and polyvinyl chloride (PVC) jacket.
 4. Max 300 pair No. 24 AWG copper conductor telecommunication cables with PVC insulation and jacket material.
 5. Max 7/C copper conductor No. 12 AWG multi-conductor power and control cables with PVC or cross-linked polyethylene (XLPE) insulation and PVC jacket.
 6. Multiple fiber optical communication cables jacketed with PVC and having a max outside diam of 1/2 in.
 7. Max 3/C No. 12 AWG steel clad cable with copper conductors and PVC insulation material.
 8. Max 4C/750 kcmil (or smaller) aluminum or copper conductor metal clad cable with aluminum or steel armor, with or without PVC jacket.
3. Pipe Insulation — (Optional) — Pipes and tubes of the sizes noted below may be provided with one of the following types of pipe insulations:
 - A. Pipe Covering* — Nom 1-1/2 in. (38 mm) thick (or thinner) hollow cylindrical heavy density glass fiber units jacketed on the outside with an all service jacket for pipes with a nom diam of 8 in. (203 mm) (or smaller) or tubes with a nom diam of 4 in. (102 mm) (or smaller). Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product.

See Pipe and Equipment Covering — Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
 - B. Tube Insulation-Plastics+ — Nom 1 in. (25 mm) thick (or thinner) acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing for pipes or tubes with a nom diam of 2 in. (51 mm) (or smaller).

See Plastics (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.



System No. F-A-8012

FA 8012

4. Firestop System — The firestop system shall consist of the following:

- A. Packing Material — Min 4 in. (102 mm) thickness of 4 pcf (64 kg/m³) mineral wool batt insulation tightly packed into the opening as a permanent form. Packing material to be recessed from top surface of floor to accommodate the required thickness of fill material.
- B. Fill, Void or Cavity Material — Sealant* — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus flush with the top surface of the floor.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-S SIL GG or CFS-S SIL SL Sealant

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
June 23, 2016

Page: 3 of 3