



Classified by  
Underwriters Laboratories, Inc.  
to CAN/ULC-S115

# System No. W-J-8055

F Ratings — 1 and 2 Hr (See Items 1, 3 and 4)



FT Ratings — 0, 1/2, 1 and 2 Hr (See Item 2)

FH Rating — 0 Hr

FTH Rating — 0 Hr



WJ 8055

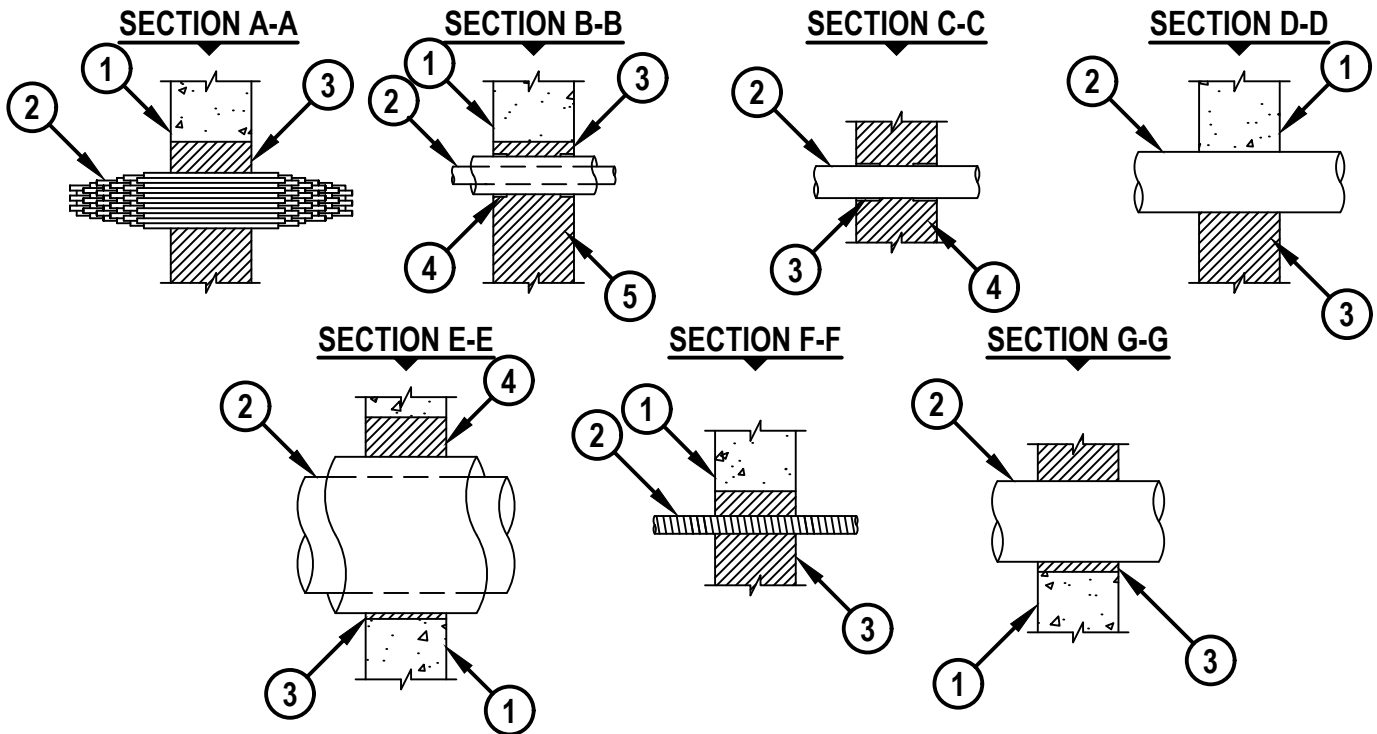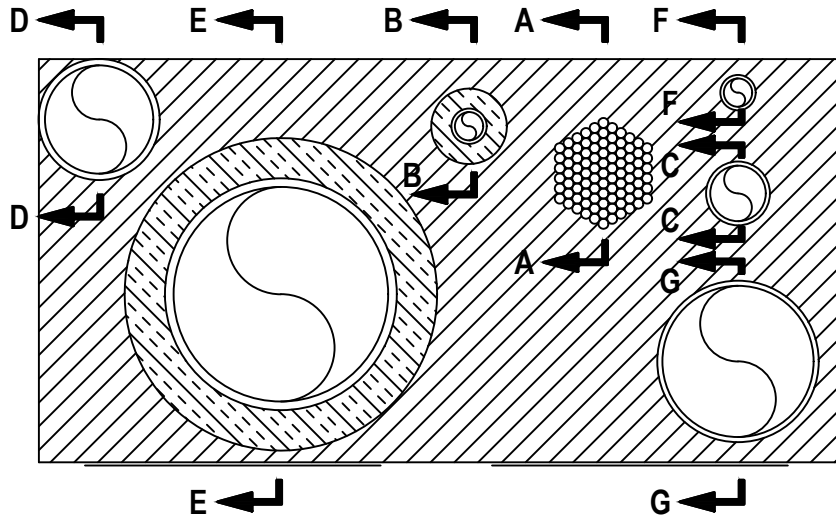

Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
January 25, 2016

1. Wall Assembly — Min 121 mm and 152 mm (4-3/4 in. and 6 in.) thick reinforced lightweight or normal weight (100-150 pcf) concrete for 1 and 2 hr, respectively. Wall may also be constructed of any solid or filled UL Classified Concrete Blocks\*. Max area of opening is 5806 cm<sup>2</sup> (900 in.<sup>2</sup>) with max dimension of 762 mm (30 in.).

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. Through Penetrants — A max of seven firestop configurations may be installed within the opening. The space between firestop configurations shall be as specified in the individual configurations. Unless otherwise indicated, the space between firestop configurations and periphery of opening shall be min 9.5 mm (3/8 in.). Pipe, conduit, tubing or cables to be rigidly supported on both sides of floor or wall assembly. The FT Rating of the system is dependent on the firestop configurations, as shown in the table below. Any combination of the following firestop configurations detailed herein may be used:

Firestop Configuration	1 Hr F Rating FT Rating Hr	2 Hr F Rating FT Rating Hr
A	0	1/2
B	1	1-1/2
C	1/2	1
D	0	0
E	1	2
F	2	0
G	3	0

**Firestop Configuration A**

2. Cables — Max 102 mm (4 in.) diam tightly bundled cables. The min space between adjacent penetrants shall be 102 mm (4 in.). Cable bundle may be any combination of the following types and sizes of cables:

- A. Max 25 pair No. 24 AWG copper telephone cables with polyvinyl chloride (PVC) insulation and jacket materials.
- B. Max 7/C No. 12 AWG cable with PVC insulation and jacket materials.
- C. Multiple fiber optical communication cables with PVC jacket material and having a max outside diameter of 3/8.
- D. Max 3/C No. 12 AWG steel clad cables with PVC insulation materials.
- E. Max 3/C No. 8 AWG cables with ground with PVC insulation and jacket materials.
- F. Max RG 59 coaxial cables with PVC insulation and jacket materials.

3. Fill, Void or Cavity Materials\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

**Firestop Configuration B**

2. Copper Tube or Pipe — Nom 25 mm (1 in.) diam (or smaller) Type L copper tube or nom 25 mm (1 in.) diam (or smaller) Regular (or heavier) copper pipe. Min space between adjacent penetrants shall be 76 mm (3 in.).

3. Tube Insulation-Plastics+ — Nom 19 mm (3/4 in.) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. The min space between adjacent penetrants shall be 38 mm (1-1/2 in.).

See Plastics+ (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.

4. Firestop System — The firestop system shall consist of the following:

A. Fill, Void or Cavity Materials\* — Wrap Strip — Nom 4.8 mm (3/16 in.) thick by 25 mm (1 in.) wide intumescent wrap strip. The wrap strip is continuously wrapped around the outer circumference of the pipe covering one time and held in place with tape. Wrap strips are installed flush with each side of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 648-E W25/1" Wrap Strip

B. Fill, Void or Cavity Material\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

Firestop Configuration C

2. Polyvinyl Chloride (PVC) Pipe — Nom 51 mm (2 in.) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems. The min space between non-metallic penetrants shall be 25 mm (1 in.). The min space between metallic penetrants shall be 89 mm (3-1/2 in.).

3. Firestop System — The firestop system shall consist of the following:

A. Fill, Void or Cavity Materials\* — Wrap Strip — Nom 4.8 mm (3/16 in.) thick by 44 mm (1-3/4 in.) wide intumescent wrap strip. The wrap strip is continuously wrapped around the outer circumference of the pipe covering one time and held in place with tape. Wrap strips are installed flush with each side of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 648-E W45/1-3/4" Wrap Strip

B. Fill, Void or Cavity Material\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.) Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

Firestop Configuration D

2. Through Penetrant — One metallic pipe, conduit or tube to be installed either concentrically or eccentrically within the firestop system. The annular space between the pipe, conduit or tube and the periphery of the opening shall be min. 0 mm (point contact). The annular space between adjacent penetrants shall be min 89 mm (3-1/2 in.). The following types and sizes of metallic pipes, conduits or tubes may be used:

Steel Pipe — Nom 102 mm (4 in.) diam (or smaller) Schedule 10 (or heavier) steel pipe.

Iron Pipe — Nom 102 mm (4 in.) diam (or smaller) cast or ductile iron pipe.

Conduit — Nom 102 mm (4 in.) diam (or smaller) rigid steel conduit.

Conduit — Nom 102 mm (4 in.) diam (or smaller) steel electrical metallic conduit.

Copper Tubing — Nom 102 mm (4 in.) diam (or smaller) Type L (or heavier) copper tubing.

Copper Pipe — Nom 102 mm (4 in.) diam (or smaller) Regular (or heavier) copper pipe.

3. Fill, Void or Cavity Materials\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

Firestop Configuration E

2. Steel Pipe — Nom 203 mm (8 in.) diam (or smaller) Schedule 40 (or heavier) steel pipe.

3. Pipe Covering Materials\* — Nom 38 mm (1-1/2 in.) thick hollow cylindrical heavy density (min 3.5 pcf) glass fiber units jacketed on the outside with an all-service jacket. Longitudinal joints sealed with metal fasteners or factory-applied, self-sealing lap tape. Transverse joints secured with metal fasteners or with butt.

See Pipe and Equipment Covering — Materials (BRGU) Category in the Building Materials Directory for names of manufacturers. Any pipe covering meeting the above specification and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

4. Fill, Void or Cavity Materials\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam



Firestop Configuration F

2. Flexible Conduit — Nom 25 mm (1 in.) diam (or smaller) flexible steel conduit. The min space between adjacent penetrants shall be 89 mm (3-1/2 in.).
3. Fill, Void or Cavity Materials\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).  
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

Firestop Configuration G

2. Steel Duct — Nom 152 mm (6 in.) diam (or smaller) No. 28 gauge (or heavier) galv steel duct. The min space between adjacent penetrants shall be 38 mm (1-1/2 in.).
3. Fill, Void or Cavity Materials\* — Foam — Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F Rating is 121 mm (4-3/4 in.). Min fill material thickness for 2 hr F Rating is 152 mm (6 in.).  
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 660 Firestop Foam

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.