

COMMERCIAL BUILDING					
Floor Substrate: Concrete over metal deck					
SHEET	MEP PENETRATIONS THRU	SYSTEM	DESCRIPTION		
1.1	FLOORS	F-A-1016	METAL PIPE THROUGH CONCRETE FLOOR (2-HR)		
		F-A-2012	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)		
		F-A-2025 (CUL)	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)		
		F-A-2214	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)		
		F-A-2240	XFR PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)		
		F-A-5015	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		F-A-5017	METAL PIPE WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		F-A-5046	METAL PIPE WITH AB/PVC OR GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		C-AJ-1226	METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-1291	METAL PIPE THROUGH CONCRETE FLOOR (2-HR)		
		CAJ-1513	MULTIPLE METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-2035	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-2079	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-3283	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)		
1.2	FLOORS OR WALLS	C-AJ-5090	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		C-AJ-5091	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		C-AJ-6042	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-7051	METAL DUCT (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2-HR)		
		C-AJ-7084	ROUND SHEET METAL DUCT THROUGH CONCRETE FLOOR (2-HR)		
		CAJ-7111	METAL DUCT (WITHOUT DAMPER) THROUGH CONCRETE FLOOR (2-HR)		
		CAJ-7145	SHEET METAL DUCT WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)		
		C-AJ-8099	MULTIPLE PENETRATION THROUGH CONCRETE FLOOR (2-HR)		
		C-AJ-8143	MULTIPLE PENETRATIONS THROUGH CONCRETE FLOOR (2-HR)		
		WL-1054	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-1389	MULTIPLE METAL PIPES THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-2028	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-2578	X-FR PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-3334	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
1.3	GYPSUM WALLS	WL-3414	CABLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-5028	METAL PIPE WITH AB/PVC INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-5029	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-7042	METAL DUCT (WITHOUT DAMPER) THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-7195	METAL DUCT THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		WL-7196	METAL DUCT WITH GLASS FIBER INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
		W-J-3215	CABLE THROUGH CONCRETE OR BLOCK WALL ASSEMBLY (2-HR)		
		1.4	CONCRETE OR MASONRY WALLS	W-J-3215	CABLE THROUGH CONCRETE OR BLOCK WALL ASSEMBLY (2-HR)
		1.5	MEMBRANE PENETRATION	CLIV-76	MEMBRANE PENETRATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)

SHEET	JOINTS	SYSTEM	DESCRIPTION
1.6	GYPSUM WALL	BW-S-0002	BOTTOM OF WALL (2-HR)
		HW-D-0042	TOP OF WALL JOINT (2-HR)
		HW-D-0045	TOP OF WALL JOINT (2-HR)
		HW-D-0049	TOP OF WALL JOINT (2-HR)
		HW-D-0085	TOP OF WALL JOINT (2-HR)
		HW-D-0184	TOP OF WALL JOINT (2-HR)
		HW-D-0259	TOP OF WALL JOINT (2-HR)
		HW-D-0324	TOP OF WALL JOINT (2-HR)
		HW-D-0342	TOP OF WALL JOINT (2-HR)
		HW-D-0569	TOP OF WALL JOINT (2-HR)
		HW-D-0570	TOP OF WALL JOINT (2-HR)
1.7	GYPSUM SHAFT WALL	HW-D-0569	TOP OF WALL JOINT (2-HR)
1.8	CONCRETE OR MASONRY WALLS	HW-D-1037	TOP OF WALL JOINT (2-HR)

UL FIRE RESISTANCE DIRECTORY NOMENCLATURE

Through Penetrations

First letter represents what is being penetrated	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: CAJ1150
F = FLOOR W = WALLS C = FLOORS OR WALLS (COMBINED)	A = CONCRETE FLOORS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 5 IN B = CONCRETE FLOORS WITH A MINIMUM THICKNESS GREATER THAN 5 IN C = FRAMED FLOORS E = FOR-CEILING ASSEMBLIES CONSISTING OF CONCRETE WITH MEMBRANE PROTECTION J = CONCRETE OR MASONRY WALLS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 8 IN L = FRAMED WALLS	0000 - 0999 BLANK OPENINGS 1000 - 1999 METAL PIPE, CONDUIT OR TUBING 2000 - 2999 NON METALLIC PIPE CONDUIT OR TUBING 3000 - 3999 CABLES 4000 - 4999 CABLE TRAYS 5000 - 5999 INSULATED PIPES 6000 - 6999 MISCELLANEOUS ELECTRICAL (BUSWAY) 7000 - 7999 MISCELLANEOUS MECHANICAL 8000 - 8999 MIXED PENETRATING ITEMS 9000 - 9999 RESERVED FOR FUTURE USE	C = FLOOR OR WALLPENETRATION A = CONCRETE FLOORS 5" OR LESS J = CONCRETE OR MASONRY WALLS 8" OR LESS 1150 = METAL PIPE, CONDUIT OR TUBING

Joint Systems

First letters identify the type of joint:	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: HWD0757
CJ = CONTINUITY HEAD OF WALL FF = FLOOR TO FLOOR WW = WALL TO WALL FW = FLOOR TO WALL HW = HEAD TO WALL BW = BOTTOM OF WALL	S = NO MOVEMENT (STATIC) D = ALLOWS MOVEMENT (DYNAMIC)	0000 - 0999 LESS THAN OR EQUAL TO 2" 1000 - 1999 GREATER THAN 2" AND LESS THAN OR EQUAL TO 6" 2000 - 2999 GREATER THAN 6" AND LESS THAN OR EQUAL TO 12" 3000 - 3999 GREATER THAN 12" AND LESS THAN OR EQUAL TO 24" 4000 - 4999 GREATER THAN 24"	HW = HEAD TO WALL D = ALLOWS MOVEMENT (DYNAMIC) 0757 = LESS THAN OR EQUAL TO 2"

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - Fire Rating (F-Rating)
 - Temperature Rating (T-Rating)
 - Leakage Rating (L-Rating)
 - Water Rating (W-Rating)
 - Annular Space
 - Percent Fill
 - Movement
 - Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - NFPA 101 Life Safety Code
 - NFPA 70 – National Electric Code
 - All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - Warning! - Do Not Disturb Through Penetration Firestop System
 - UL System # * Product(s) used
 - Hourly Rating (F-Rating)
 - Installation Date
 - Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: _____
Index of Drawings

SHEET NUMBER: _____

System No. W-J-3215

ANSI/UL 1479 (ASTM E814)	CANULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Rating — 1/2 and 2 Hr (See Item 2)	FT Ratings — 1/2 and 2 Hr (See Item 2)
L Rating at Ambient — Less than 1	PH Rating — 2 Hr
CFM/Opening	
T Rating at 400°F — Less than 1	
CFM/Opening	
	L Rating at Ambient — Less than 1
	CFM/Opening
	L Rating at 400°F — Less than 1
	CFM/Opening

SECTION A-A

Hilti Firestop Systems

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 16, 2015

Page 1 of 2

System No. W-J-3215

1. Wall Assembly — Min 6 in. (152 mm) thick lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Block*. Opening may be round, rectangular or irregular with a max diam or dimension of 1 in. (25 mm).

2. See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

3. Cables — Single or split bundles of cables to be installed within the opening. Aggregate cross-sectional area of cables in opening to have a residual of min 7% to max 10%. The annular space between the cable bundle and the periphery of the opening to be min 0.1 in. (joint contact). Cables to be rigidly supported on both sides of the wall assembly. Any combination of the following types and sizes of cables may be used:

A. Max 3C No. 14 AWG (30 AWG copper conductor cable (Belden) with PVC insulation and jacket

B. Max 10C No. 12 AWG (30 AWG copper conductor control cable with PVC or PLF insulation and jacket

C. Max 100 pair No. 24 AWG (or smaller) copper conductor telecommunication cable with PVC or plenum rated insulation and jacketing

D. Max 4C No. 22 AWG (or smaller) Cat 5E copper cables with PVC or plenum rated insulation and jacketing

E. Type (R) Coaxial cable with minimum 1/8 in. of PVC insulation and jacketing having a max outside diameter of 1/4 in. (3 mm)

F. Max 24 fiber optic cable with polyimide (PVC) or polyethylene (PE) jacket and insulation.

G. Through penetrating module — Max two copper conductor No. 18 AWG (or smaller) Power or Non-Power Limited Fire Alarm Cable with or without a jacket under a single entry.

H. Maximum 3C No. 14 AWG metal-clad cable.

The Hours, T, FT, and FTN Ratings of the firestop system are 2 hr except that for cable type (B) and (C), the ratings are 1 hr. For blank openings with no penetrations, the F, FT, FTN and FTN Ratings are 2 hr.

3. Pl. "Void or Cavity Insulation" — Min 1/2 in. (13 mm) thick rigid, non-combustible. Paper-backed or disc to be removed and disc firmly pressed around the cable bundle lapsing from 5 mm into cables to completely cover opening and firmly pressed to lap into the wall around perimeter of opening. Disc must be firmly pressed and sealed tight. Disc to be installed at both surfaces of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-D 1 Firestop Cable Disc

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Hilti Firestop Systems

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 16, 2015

Page 2 of 2

Notes:

1. Refer to the following specifications for firestopping.
 - a. 07 84 00 Firestopping
 - b. 07 84 13 Penetration Firestopping
 - c. 07 84 43 Joints Firestopping
 - d. 22 00 00 Plumbing
 - e. 23 00 00 HVAC
 - f. 26 00 00 Electrical
 - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

2. Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

4. References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

6. All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____




CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME:
Commercial - Concrete Over Metal Deck - Concrete or Masonry Walls

SHEET NUMBER: _____

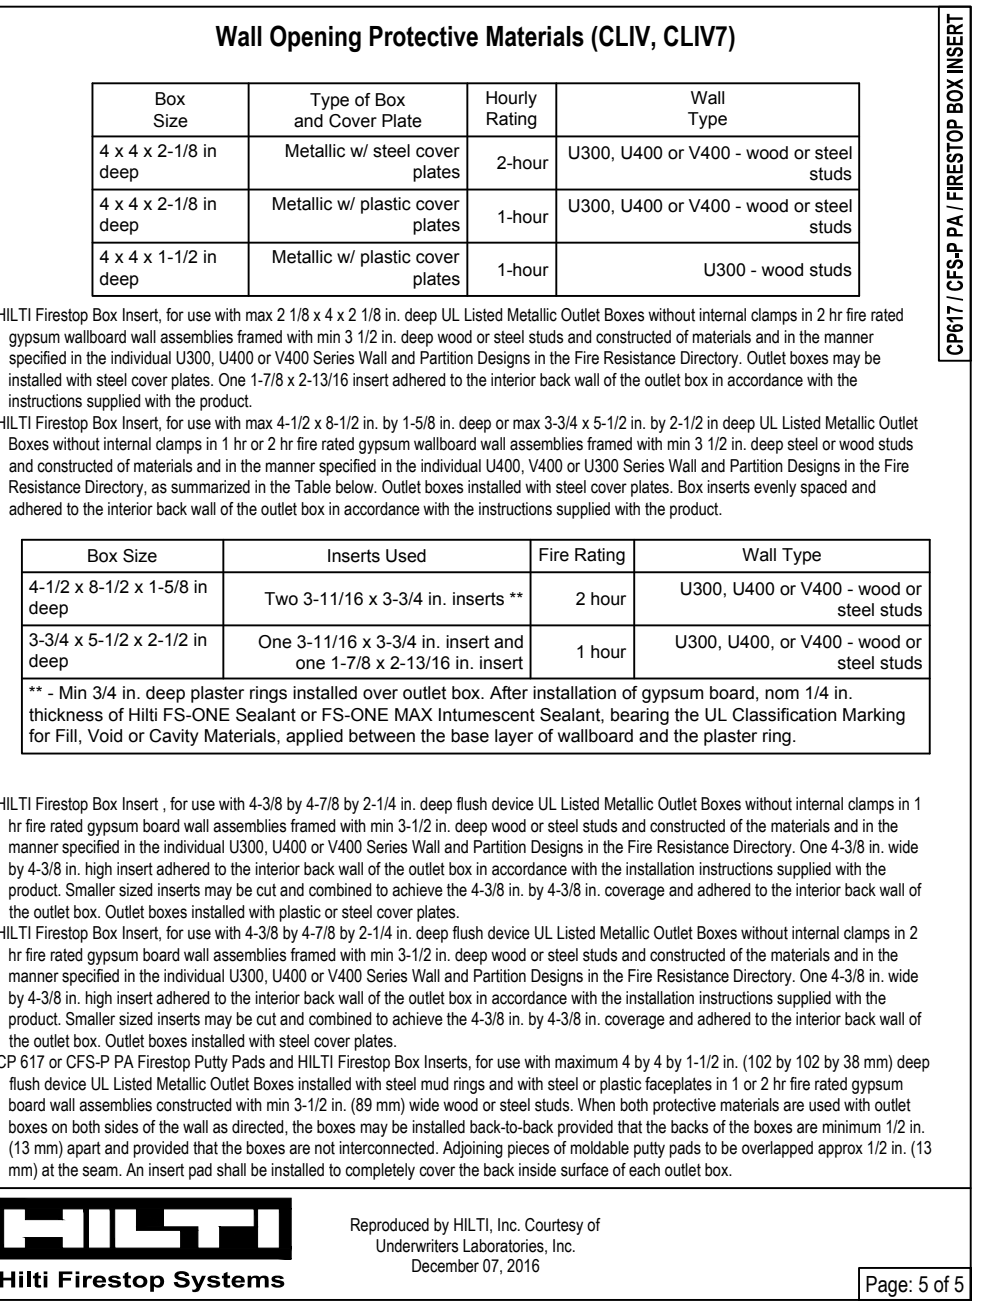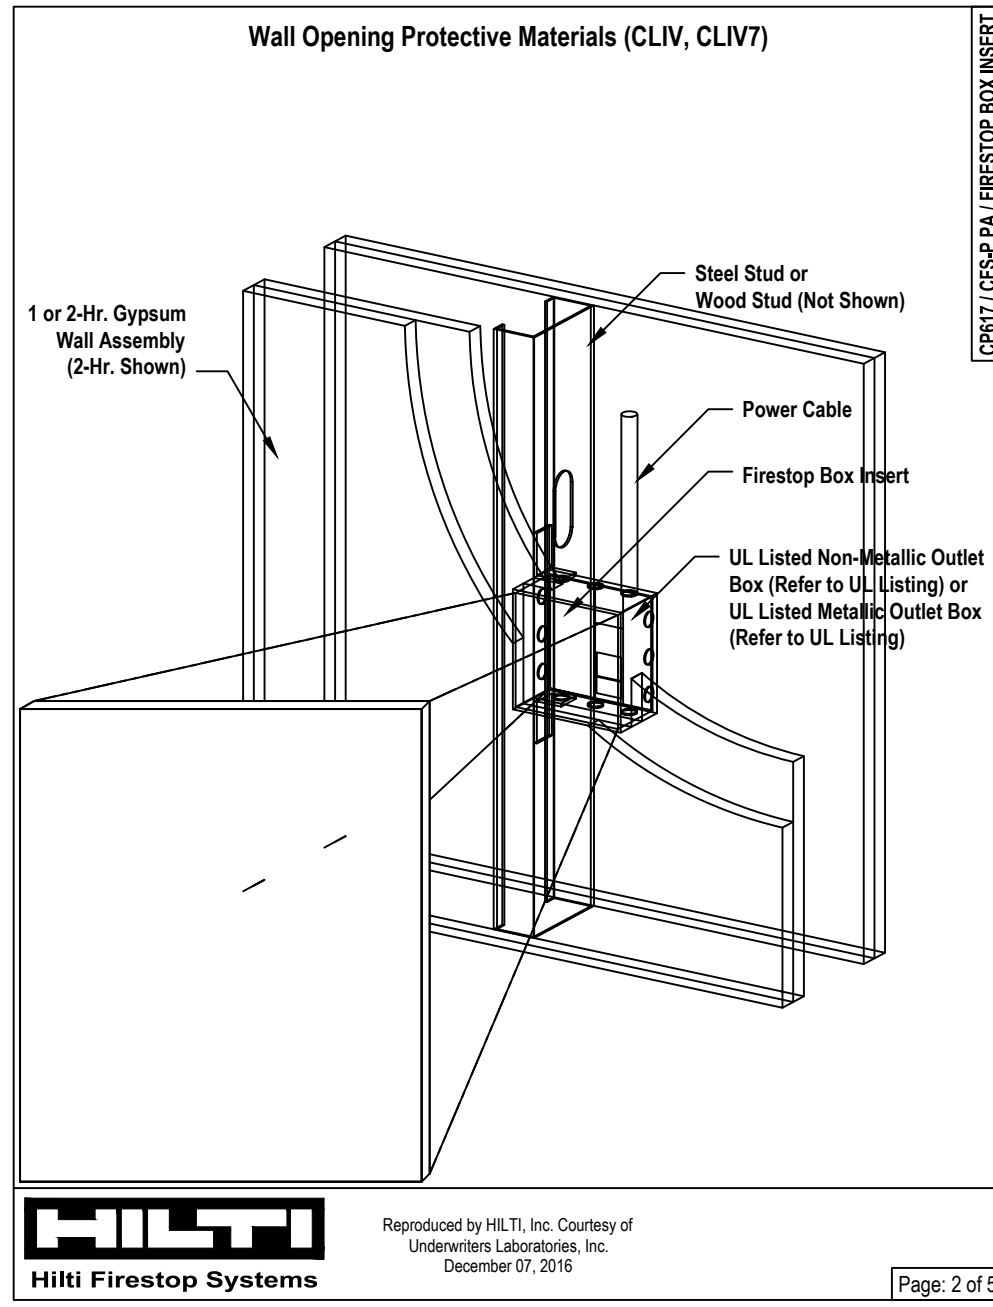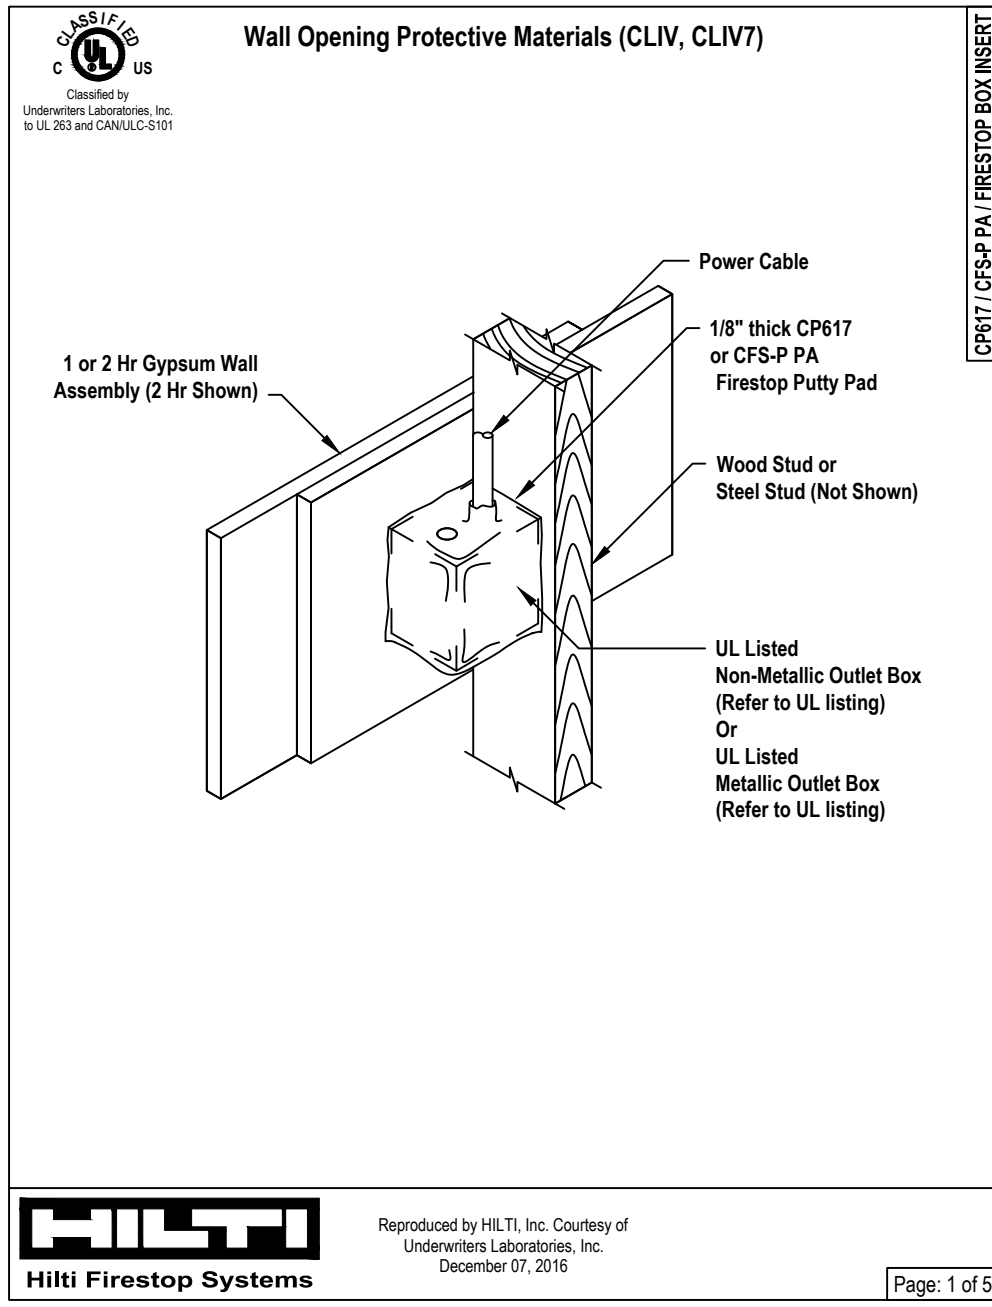

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 1 of 5

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 2 of 5

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 3 of 5

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 4 of 5

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 5 of 5

Notes:

1. Refer to the following specifications for firestopping.
 - a. 07 84 00 Firestopping
 - b. 07 84 13 Penetration Firestopping
 - c. 07 84 43 Joints Firestopping
 - d. 22 00 00 Plumbing
 - e. 23 00 00 HVAC
 - f. 26 00 00 Electrical
 - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

2. Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

4. References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

6. All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, Category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriters' Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: Commercial - Concrete Over Metal Deck - Membrane Penetration

SHEET NUMBER: _____

System No. HW-D-1037
Assembly Rating - 2 Hr
Nominal Joint Width - 3/4" (2 in.)
Class II Movement Capabilities - 14% Compression and Extension

1. Floor Assembly — The fire-rated fused steel floor/anticoncrete floor assembly shall be constructed of the materials and in the manner described in the individual Floor/Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
A. Steel Floor and Form Units — Max 3 in. (76 mm) deep galv steel fused floor units.
B. Concrete — Min 2 1/2 in. (64 mm) thick structural concrete, as measured from the top flange of the floor units.
C. Spray Applied Fire Resistant Material — (Optional) — (Not Shown) — Prior to the installation of the forming material and fill, void or cavity material (Items 2A, 2B) the steel floor units may be sprayed with a min 5/16 in. (8 mm) to max 1/32 in. (14 mm) thickness of the resistive material.
FR-GRACE (G-2) CONCRETE — Type III (M-101)
1A. Roof Assembly (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual FR90 Series Roof/Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3 in. (76 mm) deep galv steel fused roof deck.
B. Roof Insulation — Min 2 1/4 in. (57 mm) thick insulating concrete, as measured from the top flange of the floor units.
1B. Roof Assembly — As an alternate to Items 1 and 1A, a fire-rated precast fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual FR90 Series Roof/Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3 in. (76 mm) deep galv steel fused roof deck.
B. Spray Applied Fire Resistant Material — (Not Shown) — Prior to the installation of the steel ceiling runners, Forming Material and Fill, Void or Cavity Material (Items 2A, 2B, 3B), the roof assembly shall be sprayed with the type and thickness of fire resistive material indicated in the individual FR90 Series Design.
2. Wall Assembly — Min 6 in. (152 mm) thick steel reinforced lightweight or normal weight (100-150 pcf) (900-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified Concrete Block.
 See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

3. Joint System — Max separation between bottom of floor units and top of concrete wall at time of installation is 5-1/2 in. (89 mm). The joint system is designed to accommodate a max 14 percent compression or extension from its installed width. The joint system shall consist of the following:
A. Forming Material — Min 4 in. (102 mm) thick pieces of nominal 4 pcf (64 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the hole). Additional pieces of steel insulation, min 6 in. (152 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fused floor or roof units and top of concrete wall.
THERMAT BEER INC. — Type S4F
A1. Forming Material — (Plugs) — (Optional Not Shown) Performed mineral wool plugs, formed in the shape of the fused floor units, Section B to completely fill the hole above the ceiling runner. The plugs shall be flush with both wall surface. Additional forming material, described in Item 2A, to be used in conjunction with the plugs to fill the gap between the top of the wall and the bottom of the steel floor units.
HILTI CONSTRUCTION CHEMICALS, DIV. OF HILTI INC. — CP1777 Speed Plug
A2. Forming Material — As an alternate to Item 2A, min 2 pcf (50 kg/m³) ceramic blanket insulation installed in joint as a permanent form. Nominal 4 in (102 mm) thick pieces of nominal 4 pcf (64 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the hole). Additional pieces of steel insulation, min 6 in. (152 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fused floor or roof units and top of concrete wall.
B. Void or Cavity Material — (Optional) — A 1/8 in. (3.2 mm) thick thickness of FR material (topped of inside on each side of wall) to completely cover mineral wool forming material and to overlap a min. 1/2 in. (13 mm) onto steel floor units and concrete wall. When spray applied the positive expansion is applied to the steel deck, the FR material is to overlap the wall a min. 1 in. and the spray applied fire resistive material a min of 2 in. (51 mm) on both sides of the wall.
HILTI CONSTRUCTION CHEMICALS, DIV. OF HILTI INC. — CP1822 Firestop Spray or CP3-SF VBI Firestop Joint Spray

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. December 14, 2012

HILTI Firestop Systems

Page 1 of 2

System No. HW-D-1037

3. Joint System — Max separation between bottom of floor units and top of concrete wall at time of installation is 5-1/2 in. (89 mm). The joint system is designed to accommodate a max 14 percent compression or extension from its installed width. The joint system shall consist of the following:
A. Forming Material — Min 4 in. (102 mm) thick pieces of nominal 4 pcf (64 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the hole). Additional pieces of steel insulation, min 6 in. (152 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fused floor or roof units and top of concrete wall.
THERMAT BEER INC. — Type S4F
A1. Forming Material — (Plugs) — (Optional Not Shown) Performed mineral wool plugs, formed in the shape of the fused floor units, Section B to completely fill the hole above the ceiling runner. The plugs shall be flush with both wall surface. Additional forming material, described in Item 2A, to be used in conjunction with the plugs to fill the gap between the top of the wall and the bottom of the steel floor units.
HILTI CONSTRUCTION CHEMICALS, DIV. OF HILTI INC. — CP1777 Speed Plug
A2. Forming Material — As an alternate to Item 2A, min 2 pcf (50 kg/m³) ceramic blanket insulation installed in joint as a permanent form. Nominal 4 in (102 mm) thick pieces of nominal 4 pcf (64 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the hole). Additional pieces of steel insulation, min 6 in. (152 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fused floor or roof units and top of concrete wall.
B. Void or Cavity Material — (Optional) — A 1/8 in. (3.2 mm) thick thickness of FR material (topped of inside on each side of wall) to completely cover mineral wool forming material and to overlap a min. 1/2 in. (13 mm) onto steel floor units and concrete wall. When spray applied the positive expansion is applied to the steel deck, the FR material is to overlap the wall a min. 1 in. and the spray applied fire resistive material a min of 2 in. (51 mm) on both sides of the wall.
HILTI CONSTRUCTION CHEMICALS, DIV. OF HILTI INC. — CP1822 Firestop Spray or CP3-SF VBI Firestop Joint Spray

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. December 14, 2012

HILTI Firestop Systems

Page 2 of 2

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 * Minimum and maximum Width of Joints
 * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
 * If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
4. References:
 * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 * Intertek Directory of Building Products
 * All governing local and regional building codes

Current as of November 19, 2017.
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)"

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME:
 Commercial - Concrete
 Over Metal Deck -
 Concrete or Masonry
 Walls

SHEET NUMBER: _____