

HEALTHCARE BUILDING			
Floor Substrate: Concrete over metal deck			
SHEET	MEP PENETRATIONS THRU	SYSTEM	DESCRIPTION
2.1	FLOORS	F-A-1016	METAL PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2012	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2025 (G/L)	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2214	PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-2240	XFR PLASTIC PIPE THROUGH CONCRETE FLOOR (2-HR)
		F-A-5015	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE FLOOR (2-HR)
		F-A-5017	METAL PIPE WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2-HR)
		F-A-5046	METAL PIPE WITH AB/PVC OR GLASS FIBER INSULATION THROUGH CONCRETE FLOOR
		CA-J-1228	METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-1291	METAL PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-1513	MULTIPLE METAL PIPES THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-2035	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-2079	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-3095	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-3216	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)
		CA-J-3283	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2-HR)
		2.2 / 2.3	FLOORS OR WALLS
CA-J-4094	CABLE TRAY THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-5090	METAL PIPE WITH AB/PVC INSULATION THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-5091	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-6017	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-6042	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-7051	METAL DUCT (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-7084	ROUND SHEET METAL DUCT THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-7111	METAL DUCT (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-7145	METAL DUCT WITH GLASS FIBER INSULATION THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-8099	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2-HR)		
CA-J-8143	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2-HR)		
W-L-1054	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-1389	MULTIPLE METAL PIPES THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-2028	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-2578	XFR PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W/PF 60-01	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-3065	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-J-3198	CABLE BUNDLE THROUGH CONCRETE OR BLOCK WALL ASSEMBLY (2-HR)		
W-L-3272	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-3334	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-3395	MULTIPLE CABLE BUNDLES THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-3396	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-3414	CABLE THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-4011	CABLE TRAY THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-5028	METAL PIPE WITH AB/PVC INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-5029	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-7042	METAL DUCT (WITHOUT DAMPER) THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-7155	METAL DUCT THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-7156	METAL DUCT WITH GLASS FIBER INSULATION THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
W-L-8104	MULTIPLE PENETRATIONS THROUGH GYPSUM WALL ASSEMBLY (2-HR)		
2.6	CONCRETE OR MASONRY WALLS	W-J-3189	MULTIPLE CABLE BUNDLES (2-HR)
		W-J-3200	MULTIPLE CABLE BUNDLES (2-HR)
		W-J-3215	CABLE BUNDLE (1"1") (2-HR)
2.7	MEMBRANE PENETRATION	C-LV-76	MEMBRANE PENETRATION IN GYPSUM WALL ASSEMBLY (2-HR)

SHEET	JOINTS	SYSTEM NO	DESCRIPTION
2.8	GYPSUM WALL	BW-S-0001	BOTTOM OF WALL JOINT (2-HR)
		HW-D-0042	TOP OF WALL JOINT (2-HR)
		HW-D-0045	TOP OF WALL JOINT (2-HR)
		HW-D-0049	TOP OF WALL JOINT (2-HR)
		HW-D-0085	TOP OF WALL JOINT (2-HR)
		HW-D-0184	TOP OF WALL JOINT (2-HR)
		HW-D-0218	TOP OF WALL JOINT (2-HR)
		HW-D-0259	TOP OF WALL JOINT (2-HR)
		HW-D-0324	TOP OF WALL JOINT (2-HR)
		HW-D-0342	TOP OF WALL JOINT (2-HR)
2.9	GYPSUM SHAFT WALL	HW-D-0569	TOP OF WALL JOINT (2-HR)
		HW-D-0570	TOP OF WALL JOINT (2-HR)
2.10	CONCRETE OR MASONRY WALL	HW-D-0581	TOP OF WALL JOINT (2-HR)
		HW-D-1037	TOP OF WALL JOINT (2-HR)

UL FIRE RESISTANCE DIRECTORY NOMENCLATURE

Through Penetrations

First letter represents what is being penetrated	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: CAJ1150
F = FLOOR W = WALLS C = FLOORS OR WALLS (COMBINED)	A = CONCRETE FLOORS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 5 IN B = CONCRETE FLOORS WITH A MINIMUM THICKNESS GREATER THAN 5 IN C = FRAMED FLOORS E = FOR-CEILING ASSEMBLIES CONSISTING OF CONCRETE WITH MEMBRANE PROTECTION J = CONCRETE OR MASONRY WALLS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 8 IN L = FRAMED WALLS	0000 - 0999 BLANK OPENINGS 1000 - 1999 METAL PIPE, CONDUIT OR TUBING 2000 - 2999 NON METALLIC PIPE CONDUIT OR TUBING 3000 - 3999 CABLES 4000 - 4999 CABLE TRAYS 5000 - 5999 INSULATED PIPES 6000 - 6999 MISCELLANEOUS ELECTRICAL (BUSWAY) PROTECTION 7000 - 7999 MISCELLANEOUS MECHANICAL 8000 - 8999 MIXED PENETRATING ITEMS 9000 - 9999 RESERVED FOR FUTURE USE	C = FLOOR OR WALLPENETRATION A = CONCRETE FLOORS 5" OR LESS J = CONCRETE OR MASONRY WALLS 8" OR LESS 1150 = METAL PIPE, CONDUIT OR TUBING

Joint Systems

First letters identify the type of joint:	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: HWD0757
CJ = CONTINUITY HEAD OF WALL FF = FLOOR TO FLOOR WW = WALL TO WALL FW = FLOOR TO WALL HW = HEAD TO WALL BW = BOTTOM OF WALL	S = NO MOVEMENT (STATIC) D = ALLOWS MOVEMENT (DYNAMIC)	0000 - 0999 LESS THAN OR EQUAL TO 2" 1000 - 1999 GREATER THAN 2" AND LESS THAN OR EQUAL TO 6" 2000 - 2999 GREATER THAN 6" AND LESS THAN OR EQUAL TO 12" 3000 - 3999 GREATER THAN 12" AND LESS THAN OR EQUAL TO 24" 4000 - 4999 GREATER THAN 24"	HW = HEAD TO WALL D = ALLOWS MOVEMENT (DYNAMIC) 0757 = LESS THAN OR EQUAL TO 2"

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.
- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current "Underwriter's Laboratories Fire Resistance Directory (volume 2)."

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: _____
Index of Drawings


SHEET NUMBER: _____

1. Non 2 in. (51 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.
2. Non 1 in. (25 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.
3. Non 2 in. (51 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.
4. Pipe Covering — Non 1 in. (25 mm) thick (or thinner) hollow cylindrical heavy density foam (1.24 or 1.64 g/cc) glass fiber units packed on the outside with an air space jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing top tape. Transverse joints sealed with metal fasteners or with but tape applied with the product.
5. See Pipe and Equipment Covering — Materials (BRG2) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
6. Cable Tray — (Not Shown) — Non 24 in. (19 mm) thick (or thinner) acrylonitrile butadiene styrene/polyvinyl chloride (ABS/PVC) flexible foam laminated in its ends of tubing.
7. See Plastics (GMP2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component table classification meeting the above specifications and bearing the UL Classification Marking of M-A-A may be used.
8. Cable — Non 2 in. (51 mm) diam light bundle of cables installed within the opening and rigidly supported on all sides of floor or wall assembly. The space between the cables and depth of the opening shall range from 2 in. (51 mm) to max 4 in. (102 mm). Any combination of the following types and sizes of metallic conductors of fiber optic cable may be used:
 - A. Max 100 pair No. 12 AWG copper conductor telecommunication cables with thermoplastic insulation and polyvinyl chloride (PVC) jacket.
 - B. Max 300 pair No. 24 AWG copper conductor telecommunication cables with PVC insulation and jacket material.
 - C. Max 100 pair No. 12 AWG multi-conductor power and control cables with PVC or cross-linked polyethylene (XLPE) insulation and PVC jacket.
 - D. Multiple fiber optical communication cables jacketed with PVC and having a max outside diam of 1/2 in.
 - E. Max 3/8" copper conductor No. 12 AWG multi-conductor power and control cables with PVC or cross-linked polyethylene (XLPE) insulation and PVC jacket.
 - F. Max 3/8" copper conductor No. 12 AWG with bare aluminum ground. PVC insulated steel Mesh-Clad cable.
9. Filling System — The filling system shall consist of the following:
 - A. Packing Material — Min 4 in. (102 mm) thickness of min 4 gpf (84 g/cc) mineral wool batt insulation firmly packed into opening as a permanent fill. Packing material to be recessed from top surface of floor or both surfaces of wall to accommodate the required thickness of fill material. When Precast Concrete Unit floors are used, packing material shall be installed at a thickness equal to the thickness of the floor minus 1/2 in. (13 mm). Flush with bottom surface of floor.
 - B. Fire Void or Cavity Material* — Sealed — Min 1/2 in. (13 mm) thickness of material applied within the annulus, flush with top surface of floor or both surfaces of wall.
 - C. HILTI CONSTRUCTION CHEMICALS, Div of HILTI, Inc. — FS-CONE Sealant or FS-CONE MAX Humusscent Sealant.

*Hearing the UL Recognized Component Marking
 * Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.
 * Hearing the UL Listing Mark

HILTI Firestop Systems | Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 15, 2015 | Page: 2 of 2

ANSI/UL 1479 (ASTM E814)	CANULC 0115
F Rating — 2 HR	F Rating — 2 HR
T Rating — 0 HR	T Rating — 0 HR
	ETH Rating — 2 HR
	FTH Rating — 0 HR

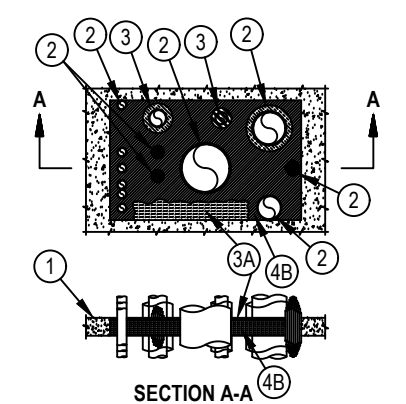

1. Floor or Wall Assembly — Min 4 1/2 in. (114 mm) thick reinforced (lightweight or normal weight (100-150 pcf or 1600-2400 kg/cc) concrete floor. Min 4 in. (102 mm) thick reinforced (lightweight or normal weight (100-150 pcf or 1600-2400 kg/cc) concrete wall. That may also be constructed of any UL Classified Concrete Block*. Max area of opening is 144 in.2 (9300 cm2) with a max dimension of 48 in. (1219 mm).
2. Through Penetration — One cable tray and one or more pipes, tubes or cable bundles may be installed within the opening. The total number of through penetrations is dependent on the size of the opening and the type and size of the penetrants. Any combination of the penetrants described below may be used provided that the following parameters relative to the annular space are maintained. The annular space between cable tray and all other penetrants shall be non 2 in. (51 mm). The annular space between individual cables and cable bundles shall be non 1/2 in. (13 mm). The annular space between individual cables and cable bundles and other penetrants shall be non 1/2 in. (13 mm) except that a min 2 in. (51 mm) shall be maintained between the cables and copper pipes and tubes greater than a non 3/8 in. (9.5 mm) diam and steel and iron pipes and conduits greater than a non 4 in. (102 mm) diam. The annular space between metallic pipes, conduits and tubes and insulated pipes and tubes shall be non 2 in. (51 mm). The annular space between non 1/2 in. (13 mm) diam (and smaller) copper pipes and tubes and between non 1 in. (25 mm) diam (and smaller) metal and iron pipes and conduits shall be non 1/2 in. (13 mm). The annular space between non 2 in. (51 mm) diam (and smaller) metallic pipes and conduits shall be non 1 in. (25 mm) joint contact. The annular space between insulated penetrants or the cable tray and the periphery of opening shall be non 1/2 in. (13 mm). The annular space between all other penetrants and the periphery of opening shall be non 5/8 in. (16 mm) joint contact. A max annular space of 1 1/2 in. (38 mm) penetrants to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of penetrants may be used:
 - A. Metallic Pipes — The following types of metallic pipes, tubes or conduits may be used:
 1. Copper Tubing — Non 8 in. (102 mm) diam (or smaller) Type 10F heavier copper tube.
 2. Copper Pipe — Non 8 in. (102 mm) diam (or smaller) regular (or heavier) copper pipe.
 3. Steel Pipe — Non 3 in. (76 mm) diam (or smaller) Schedule 40 or heavier steel pipe.
 4. Iron Pipe — Non 2 in. (51 mm) diam (or smaller) cast or ductile iron pipe.
 5. Conduit — Non 4 in. (102 mm) diam (or smaller) electric metallic tubing (EMT) or non 6 in. (152 mm) diam (or smaller) rigid steel conduit.

HILTI Firestop Systems | Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 15, 2015 | Page: 1 of 2

3. Pipe Insulation — (Optional) — Pipes and tubes of the sizes listed below may be provided with one of the following types of pipe insulation:
 - A. Pipe Covering* — Non 1 1/2 in. (38 mm) thick (or thinner) hollow cylindrical heavy density glass fiber units jacketed on the outside with an air service jacket for pipes with a non diam of 8 in. (203 mm) (or smaller) or tubes with a non diam of 4 in. (102 mm) (or smaller). Longitudinal joints sealed with metal fasteners or factory applied self-sealing top tape. Transverse joints sealed with metal fasteners or with but tape applied with the product.
 - B. Pipe Covering* — Non 2 in. (51 mm) thick (or thinner) hollow cylindrical heavy density glass fiber units jacketed on the outside with an air service jacket for pipes with a non diam of 2 in. (51 mm) (or smaller) or tubes with a non diam of 1 in. (25 mm) (or smaller). Longitudinal joints sealed with metal fasteners or factory applied self-sealing top tape. Transverse joints sealed with metal fasteners or with but tape applied with the product.
 - C. Tube Insulation/Packings* — Non 1 in. (25 mm) thick (or thinner) acrylonitrile butadiene styrene/polyvinyl chloride (ABS/PVC) flexible foam laminated in its form of tubes for pipes or tubes with a non diam of 2 in. (51 mm) (or smaller).
 - D. Cable Tray* — (Not Shown) — Non 24 in. (19 mm) thick (or thinner) acrylonitrile butadiene styrene/polyvinyl chloride (ABS/PVC) flexible foam laminated in its ends of tubing.
4. Firestop System — The firestop system shall consist of the following:
 - A. Packing Material — Min 4 in. (102 mm) thickness of min 4 gpf (84 g/cc) mineral wool batt insulation firmly packed into the opening as a permanent fill. Packing material to be recessed from top surface of floor or both surfaces of wall to accommodate the required thickness of fill material. When Precast Concrete Unit floors are used, packing material shall be installed at a thickness equal to the thickness of the floor minus 1/2 in. (13 mm). Flush with bottom surface of floor.
 - B. Fire Void or Cavity Material* — Sealed — Min 1/2 in. (13 mm) thickness of material applied within the annulus, flush with top surface of floor or both surfaces of wall.
 - C. HILTI CONSTRUCTION CHEMICALS, Div of HILTI, Inc. — FS-CONE Sealant or FS-CONE MAX Humusscent Sealant.

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.
 * Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.
 * Hearing the UL Listing Mark

HILTI Firestop Systems | Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 15, 2015 | Page: 2 of 2

1. Refer to the following specifications for firestopping.
 - a. 07 84 00 Firestopping
 - b. 07 84 13 Penetration Firestopping
 - c. 07 84 43 Joints Firestopping
 - d. 22 00 00 Plumbing
 - e. 23 00 00 HVAC
 - f. 26 00 00 Electrical
 - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

2. Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

4. References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

6. All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriter's Laboratories Fire Resistance Directory (volume 2.)'

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: Healthcare - Concrete Over Metal Deck-Gypsum Walls.

SHEET NUMBER: _____

System No. W-J-3189

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. November 20, 2015 Page 1 of 3

System No. W-J-3189

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. November 20, 2015 Page 2 of 3

System No. W-J-3189

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. November 20, 2015 Page 3 of 3

System No. W-J-3200

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. March 21, 2017 Page 1 of 3

System No. W-J-3200

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. March 21, 2017 Page 2 of 3

System No. W-J-3200

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. March 21, 2017 Page 3 of 3

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 1 of 2

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 2 of 2

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 3 of 3

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 1 of 3

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 2 of 3

System No. W-J-3215

ANSI/UL 1479 (ASTM E814) CANULC 0115

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

F Rating - 2 hr
 FF Rating - 1 1/2 hr (See Item 2)
 FTW Rating - 1 1/2 hr (See Item 2)
 L Rating at Ambient - 1.2 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)
 L Rating at 400°F - 1.3, 1.8 and Less Than 1 CFM per Device (See Items 2, 3A and 3A1)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. October 14, 2015 Page 3 of 3

- Notes:
- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriters Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER:

DRAWN:

CHECKED:

ISSUE DATE: 07-13-2018

REVISIONS:

SHEET NAME:
 Healthcare - Concrete Over Metal Deck - Concrete or Masonry Walls

SHEET NUMBER:

Wall Opening Protective Materials (CLIV, CLIV7)

Power Cable
1 1/2" Thick CP817 or CP8-PFA Firestop Putty Pad
Wood Stud or Steel Stud (Not Shown)
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page: 1 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2-Hr Gypsum Wall Assembly (2-Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page: 2 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2 Hr Gypsum Wall Assembly (2 Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page: 3 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2 Hr Gypsum Wall Assembly (2 Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page: 4 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

Box Size	Type of Box and Cover Plate	Hourly Rating	Inset Type
4 x 4 x 2-1/8 in. deep	Metallic w/ steel cover plates	2-hour	US30, U400 or V400 - wood or steel studs
4 x 4 x 2-1/8 in. deep	Metallic w/ plastic cover plates	1-hour	US30, U400 or V400 - wood or steel studs
4 x 4 x 1-1/2 in. deep	Metallic w/ plastic cover plates	1-hour	US30 - wood studs

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page: 5 of 5

- Notes:**
- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - d.22 00 00 Plumbing
 - e.23 00 00 HVAC
 - f.26 00 00 Electrical
 - g.27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, Category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriter's Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: Healthcare - Concrete Over Metal Deck - Membrane Penetration

SHEET NUMBER: _____

System No. HW-D-0342

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 1 of 2

System No. HW-D-0569

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 1 of 3

System No. HW-D-0569

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 2 of 3

System No. HW-D-0569

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 2 of 3

System No. HW-D-0569

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 1 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 2 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

System No. HW-D-0570

ANSI/AISI 209	CANULC 5115
Assembly Rating — 1 and 2 Hr (See Item 2)	F Rating — 1 and 2 Hr (See Item 2)
Normal Joint Width — 1 1/2 in.	FT Rating — 1 and 2 Hr (See Item 2)
Class I Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
Class II Movement Capabilities — 50% Compression and Extension	FTM Rating — 1 and 2 Hr (See Item 2)
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Normal Joint Width — 1 1/2 in.
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	Class I Movement Capabilities — 50% Compression and Extension
L Rating A1 Ambient — Less Than 1 CFM/Lin Ft	L Rating A1 Ambient — Less Than 1 CFM/Lin Ft

Reproduced by H.L.T.I., Inc. Courtesy of Underwriters Laboratories, Inc. March 20, 2013. Page 3 of 3

Notes:

- Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
- Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - Minimum and maximum Width of Joints
 - Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
- References:
 - 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 - Intertek Directory of Building Products
 - All governing local and regional building codes

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriters Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____


ISSUE DATE: 07-13-2018

REVISIONS: _____


SHEET NAME: _____

Healthcare - Concrete Over Metal Deck - Gypsum Shaft Wall


SHEET NUMBER: _____

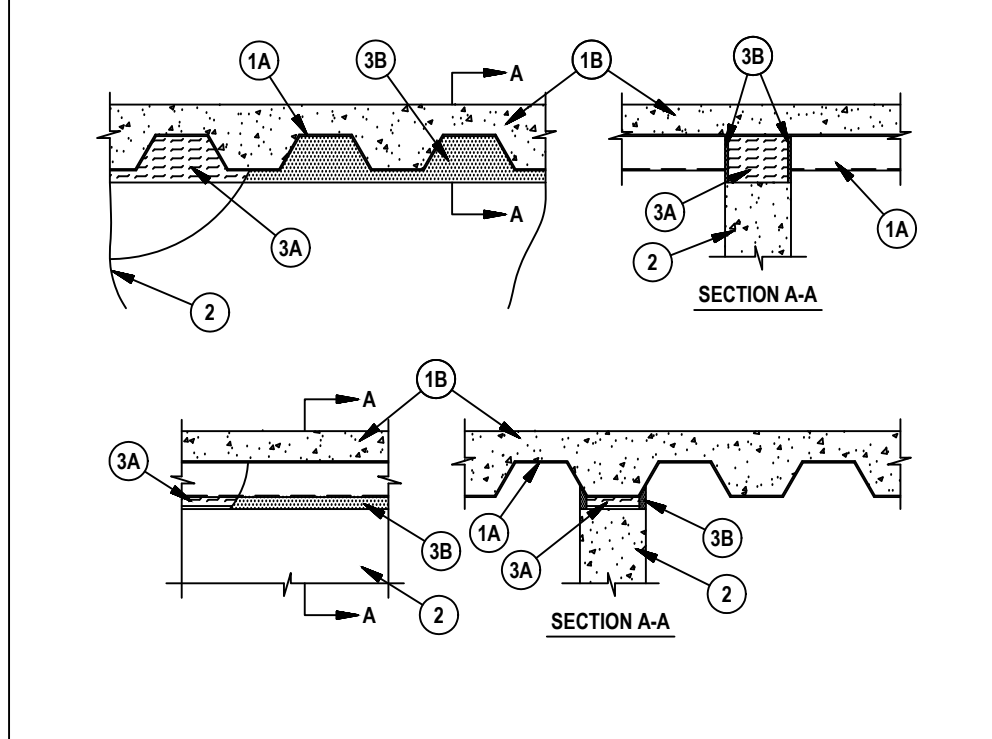


1. Floor Assembly — The fire-rated fused steel floor anticorrosive floor assembly shall be constructed of the materials and in the manner described in the individual CTSO or SSOO Floor Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
 A. Steel Floor and Form Units — Max 3 in. deep galv steel fused floor units.
 B. Concrete — Min 2 1/4 in. thick unadorned concrete, as measured from the top plane of the floor units.
 1A. Roof Assembly — (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
 A. Steel Roof Deck — Max 3 in. deep galv steel fused roof deck.
 B. Roof Insulation — Min 1 1/4 in. thick poured insulating concrete, as measured from the top plane of the floor units.
 2. Wall Assembly — Min 5 in. thick steel reinforced lightweight or normal weight (130-150 pcf) concrete. Wall may also be constructed of an UL Classified Concrete Block.
 See Concrete Block (CA27) category in the Fire Resistance Directory for names of manufacturers.

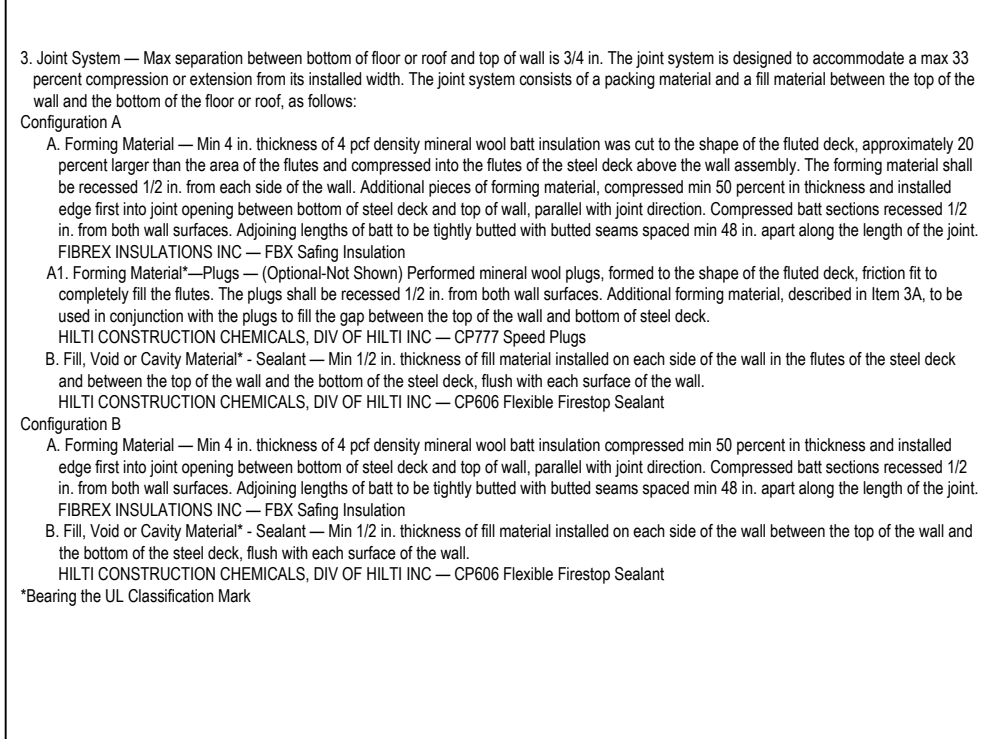

3. Joint System — Max separation between bottom of floor or roof and top of wall is 3/4 in. The joint system is designed to accommodate a max 33 percent compression or extension from its installed width. The joint system consists of a packing material and a fill material between the top of the wall and the bottom of the floor or roof, as follows:
 Configuration:
 A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation was cut to the shape of the fused deck, approximately 20 percent larger than the area of the flange and compressed into the flange of the steel deck above the wall assembly. The forming material shall be recessed 1/2 in. from each side of the wall. Additional pieces of forming material, compressed min 50 percent in thickness and installed edge to edge joint opening between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
 FIREBARRIER INSULATIONS INC. — FFI Safety Insulation
 A1. Forming Material—Fuge — (Optional-Not Shown) Performed mineral wool plug, formed to shape of the fused deck. Section fit to completely fill the flange. The plug shall be recessed 1/2 in. from both wall surfaces. Additional forming material, described in item 3A, to be used in conjunction with the plugs to fill the gaps between the top of the wall and bottom of steel deck.
 HELTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP777 Speed Plug
 B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall in the flange of the steel deck and between the top of the wall and the bottom of the steel deck, flush with each surface of the wall.
 HELTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
 Configuration:
 A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation compressed min 50 percent in thickness and installed edge to edge joint opening between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
 FIREBARRIER INSULATIONS INC. — FFI Safety Insulation
 B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall between the top of the wall and the bottom of the steel deck. Flush with each surface of the wall.
 HELTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
 Showing the U.L. Classification Mark.

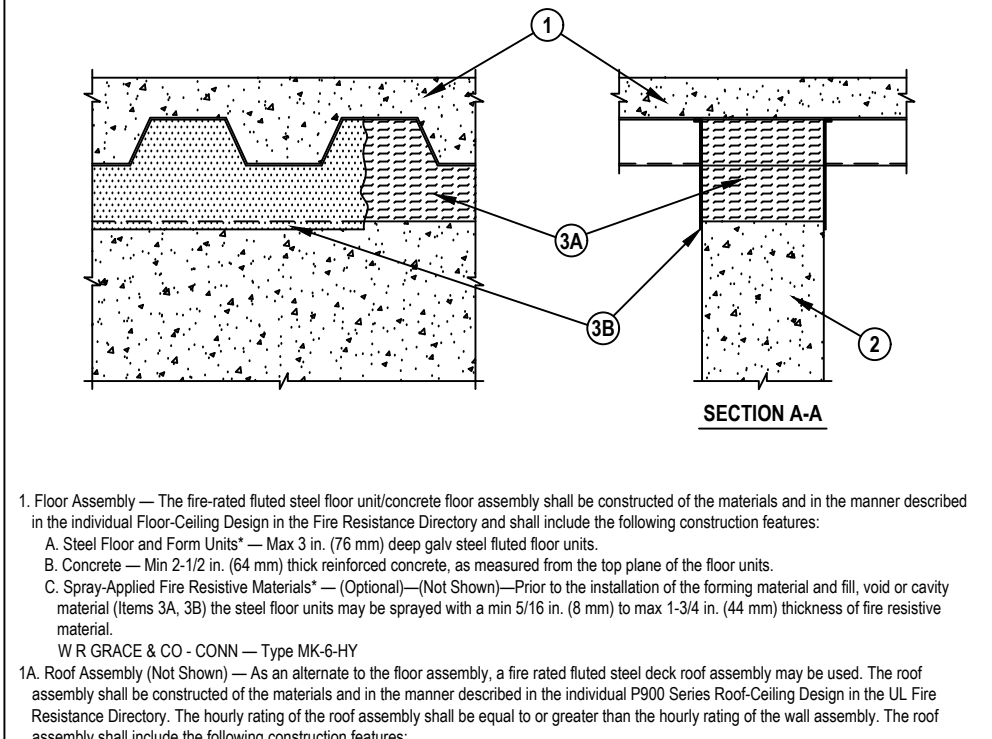

1. Floor Assembly — The fire-rated fused steel floor anticorrosive floor assembly shall be constructed of the materials and in the manner described in the individual Floor Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
 A. Steel Floor and Form Units — Max 3 in. (76 mm) deep galv steel fused floor units.
 B. Concrete — Min 2 1/4 in. (61 mm) thick unadorned concrete, as measured from the top plane of the floor units.
 C. Spray Applied Fire Resistive Material* — (Optional—Not Shown)—Prior to the installation of the forming material and fill, void or cavity material (Items 3A, 3B) the steel floor units may be sprayed with a min 5/16 in. (8 mm) to max 1/4 in. (4 mm) thickness of the resistive material.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP622 Firestop Spray or CP5-SP WB Firestop, Joint Spray
 *Showing the U.L. Classification Mark.
 1A. Roof Assembly (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
 A. Steel Roof Deck — Max 3 in. (76 mm) deep galv steel fused roof deck.
 B. Roof Insulation — Min 2 1/4 in. (61 mm) thick poured insulating concrete, as measured from the top plane of the floor units.
 1B. Roof Assembly — As an alternate to Item 1 and 1A, a fire-rated protected fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual P700 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
 A. Steel Roof Deck — Max 3 in. (76 mm) deep galv steel fused roof deck.
 B. Spray Applied Fire Resistive Material* — (Not Shown)—Prior to the installation of the steel ceiling system, Forming Material and Fill, Void or Cavity Material (Items 2A, 2B, 3B), the roof assembly shall be sprayed with the type and thickness of fire resistive material indicated in the individual P700 Series design.
 2. Wall Assembly — Min 5 in. (127 mm) thick steel reinforced lightweight or normal weight (130-150 pcf) (1800-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified Concrete Block.
 See Concrete Block (CA27) category in the Fire Resistance Directory for names of manufacturers.

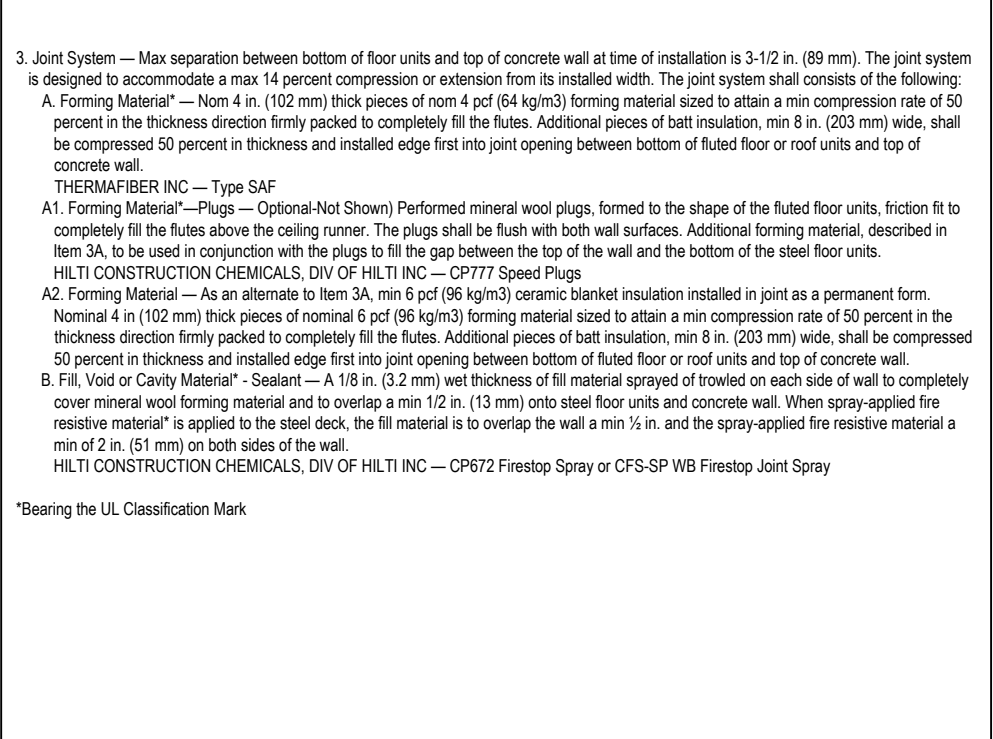

3. Joint System — Max separation between bottom of floor units and top of concrete wall at time of installation is 3/4 in. (19 mm). The joint system is designed to accommodate a max 14 percent compression or extension from its installed width. The joint system shall consist of the following:
 A. Forming Material — Nom 4 in. (102 mm) thick pieces of normal pfd (84 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (rimy packed to completely fill the flange. Additional pieces of batt insulation, min 1 in. (25 mm) wide, shall be compressed 50 percent in thickness and installed edge to edge joint opening between bottom of fused floor or roof units and top of concrete wall.
 FIREBARRIER INC. — Type SAF
 A1. Forming Material—Fuge — (Optional-Not Shown) Performed mineral wool plug, formed to the shape of the fused floor units. Section fit to completely fill the flange above the ceiling runner. The plug shall be flush with both wall surfaces. Additional forming material, described in item 3A, to be used in conjunction with the plugs to fill the gaps between the top of the wall and the bottom of the steel floor units.
 HELTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP777 Speed Plug
 A2. Forming Material — As an alternate to item 3A, min 1/2 pfd (84 kg/m³) organic sheath insulation installed in joint as a permanent form.
 Nominal 4 in (102 mm) thick pieces of normal pfd (84 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (rimy packed to completely fill the flange. Additional pieces of batt insulation, min 1 in. (25 mm) wide, shall be compressed 50 percent in thickness and installed edge to edge joint opening between bottom of fused floor or roof units and top of concrete wall.
 B. Fill Void or Cavity Material — Sealant — A 1/8 in. (3.2 mm) wide thickness of fill material (spread of material on each side of wall) to completely cover mineral wool forming material and to overlap a min 1/2 in. (13 mm) onto steel floor units and concrete wall. When spray applied the sealant material is applied to the steel deck, the fill material is to overlap the wall a min 1/4 in. and the spray applied the sealant material a min of 2 in. (51 mm) on both sides of the wall.
 HELTI CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP622 Firestop Spray or CP5-SP WB Firestop, Joint Spray
 *Showing the U.L. Classification Mark.

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 * Minimum and maximum Width of Joints
 * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
 4. References:
 * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 * Intertek Directory of Building Products
 * All governing local and regional building codes

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriters Laboratories Fire Resistance Directory (volume 2)

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 07-13-2018

REVISIONS: _____

SHEET NAME: _____
 Healthcare - Concrete Over Metal Deck - Concrete or Masonry Wall

SHEET NUMBER: _____