




Classified by
Underwriters Laboratories, Inc.
to UL 2079 and CAN/ULC-S115

System No. WW-D-0068

WW-D-0068

ANSI/UL2079	CAN/ULC S115
Assembly Ratings — 1 and 2 Hr (See Item 1)	F Ratings — 1 and 2 Hr (See Item 1)
Nominal Joint Width – 2 in.	FT Ratings — 1 and 2 Hr (See Item 1)
Class II Movement Capabilities — 12.5% Compression Or Extension	FH Ratings — 1 and 2 Hr (See Item 1)
	FTH Ratings — 1 and 2 Hr (See Item 1)
	Nominal Joint Width – 51 mm
	Class II Movement Capabilities — 12.5% Compression Or Extension

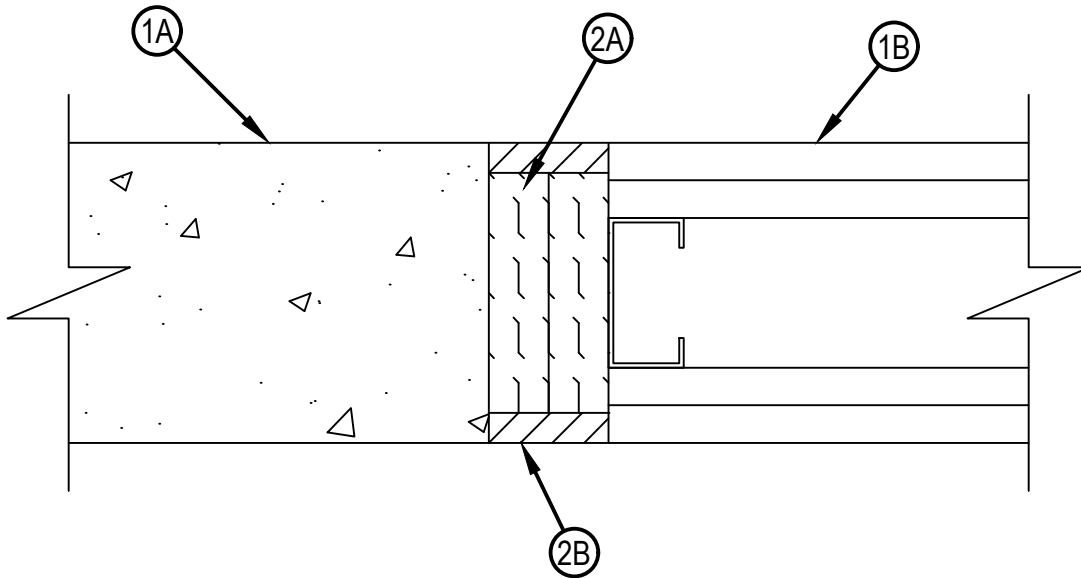

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 18, 2024

1. Wall Assembly — The wall assembly shall consist of the following:

A. Min 2-3/4 and 4 in. (70 and 102 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete for 1 and 2 hr rated assemblies, respectively. Additionally, thickness of concrete wall shall be equal to or greater than thickness of gypsum board wall. Wall may also be constructed of any UL Classified Concrete Blocks*.

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

B. Nonbearing 1 or 2 hr fire rated gypsum board/steel stud assembly constructed of the materials and in the manner described in the individual U400 or V400 Series Wall and Partition Design in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Min 1-1/2 in. (38 mm) wide steel studs spaced max 24 in. (610 mm) OC.

B. Gypsum Board* — The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U400 or V400 Series Design in the UL Fire Resistance Directory.

The hourly assembly rating of the joint system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. Joint System — Max width of joint (at time of installation of joint system) is 2 in. (51 mm) The joint system is designed to accommodate a max 12.5 percent compression or extension from its installed width. The joint system shall consist of the following:

A. Forming Material* — Min 4.0 pcf (64 kg/m³) mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min width of 1-3/4 or 3 in. (44 or 76 mm) for 1 and 2 hr rated assemblies, respectively. Pieces of batt installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 50 percent in thickness and such that the compressed batt sections are recessed from both surfaces of gypsum board wall to accommodate the required thickness of fill material.

B. Fill, Void or Cavity Material* - Sealant — Min 1/2 in. (13 mm) thickness of fill material applied within the joint, flush with both surfaces of gypsum board wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP606 Flexible Firestop Sealant

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

